
AIRSTAGE

FUJITSU

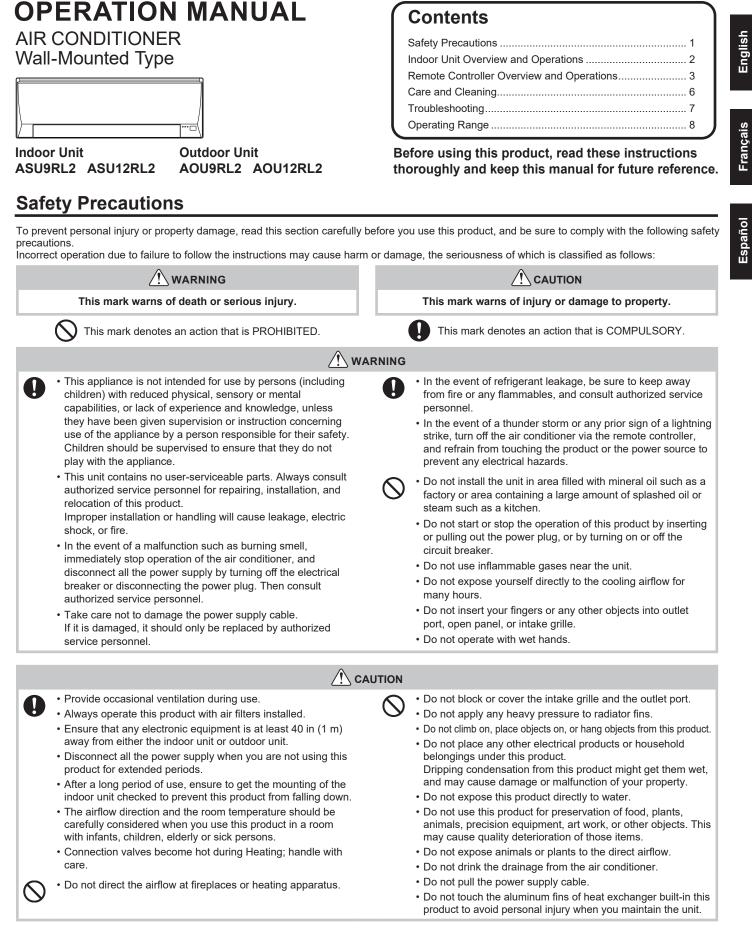

FUJITSU GENERAL LIMITED

3-3-17, Suenaga, Takatsu-ku, Kawasaki 213-8502, Japan

1 Intake grille

Before starting operation, make sure that the intake grille has been shut completely. Incomplete closing might have an effect on the proper working or performance of the product.

2) **MANUAL AUTO button**

Use when you lost the remote controller or remote control malfunction occurs.

Status	Action	Mode or operation
In operation	Press more than 3 seconds.	Stop
Stopping	Press more than 3 seconds and less than 10 seconds.	AUTO
	Press more than 10 seconds. (Only for servicing.*)	Forced cooling
After cleaning	Press less than 3 seconds.	Filter indicator reset

*: To stop forced cooling, press this button or START/STOP button on the remote controller.

Front panel (3)

Vertical airflow direction louver 4

Each time you press Vertical SET button on the remote controller, the angle of the vertical airflow direction louver moves as follows:



COOL, DRY or FAN mode	HEAT mode
$1^* \stackrel{\sim}{\longrightarrow} 2 \stackrel{\sim}{\longleftarrow} 3 \stackrel{\sim}{\longleftarrow} 1$	$4 \stackrel{\longrightarrow}{\leftarrow} 5 \stackrel{\longrightarrow}{\leftarrow} 6 \stackrel{\longrightarrow}{\leftarrow} 7^*$

*: Default setting in each mode.

- · Do not adjust by hand.
- At the beginning of AUTO or HEAT mode, they may stay position 1 for a while for adjustment.
- If you set the angle to position 5-7 for more than 30 minutes in COOL or DRY mode, they automatically return to position 4. In COOL or DRY mode, if the angle is set to position 5-7 for many hours, condensation may be formed, and the drips may wet your property.

5) **Drain hose**

Remote controller signal receiver 6

CAUTION

For appropriate signal transmission between remote controller and the indoor unit, keep the signal receiver away from following items:

- Direct sunlight or other strong light
 - Flat-panel television screen

In rooms with instantaneous fluorescent lights, such as inverter type ones, the signal may not be transmitted properly. In such a case, consult the store that you purchased the product.

(7) ECONOMY indicator (green)

Lights in ECONOMY operation.

(8) TIMER indicator (orange)


Lights in TIMER operation, and blinks slowly when the timer setting error is detected.

As for the timer setting error, refer to "Auto-restart function" on page 4.

9) **OPERATION** indicator (green)


Lights in normal operation, and blinks slowly in automatic defrosting operation

10 Horizontal airflow direction louvers




the vertical airflow direction louver has been stopped completely.

Adjust two knobs by hand.

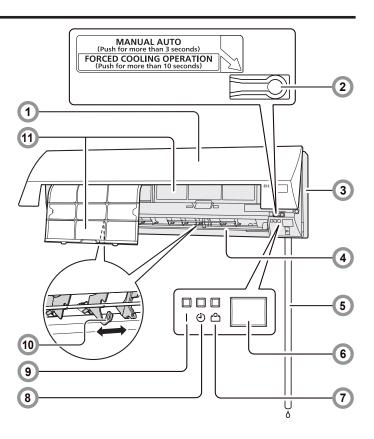

11 Air filter

Easy-to-care air filters resist mildew growth.

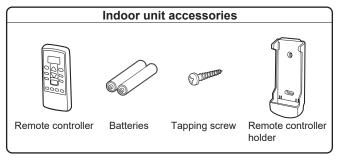


See page 6

/!\ WARNING

Take care to prevent infants and young children from accidentally swallowing the batteries.

Battery (AAA/R03/LR03 × 2) loading

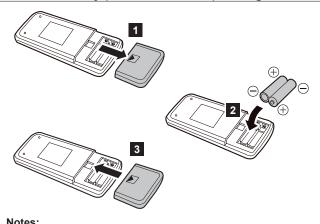

Notes:

- · Use specified type of battery only.
- Do not mix different types or new and used batteries together.
- Batteries can be used about 1 year in ordinary use.
- · If the remote control range noticeably got shorten, replace the batteries, and press RESET button.

Remote Controller Overview and Operations



*


*

*

*

*

- To prevent malfunction or damage of the remote controller: Place remote controller at where will not be exposed to direct sunlight or excessive heat.
 - Remove batteries if the product is not going to be used for an extended period.
 - Exhausted batteries must be removed immediately, and be disposed according to the local laws and regulations of vour region.

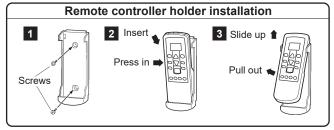

You can quickly start the operation with following 3 steps:

 \rightarrow AUTO \rightarrow COOL \rightarrow DRY \rightarrow FAN \rightarrow HEAT \cdot

(1)**START/STOP** button

2 **MODE** button

Switches operation mode in following order.

Notes in HEAT mode:

- · At the beginning of the operation, the indoor unit operates at very low fan speed for about 3-5 minutes for preparation, and then switches to the selected fan speed.
- · Automatic defrosting operation overrides the heating operation when it is necessary.

SET TEMP. (temperature) buttons (3)

Set desired temperature.

Temperature setting range		
AUTO	64-88°F (18-30°C)	
COOL/DRY	64-88°F (18-30°C)	
HEAT	60–88°F (16–30°C)	

*:Temperature control is not available in FAN mode.

FAN button (4)

Controls the fan speed.

 \rightarrow AUTO \rightarrow HIGH \rightarrow MED \rightarrow LOW \rightarrow QUIET

· When AUTO is selected, the fan speed is automatically adjusted according to the operation mode.

5 Vertical SET button

Adjusts the vertical airflow direction.

6 SWING button

Starts or stops automatic swing of the vertical airflow direction louver. · Each time you press the button, the vertical airflow direction louver swings as follows:

COOL. DRY or FAN **HEAT** mode mode $4 \overrightarrow{} 5 \overrightarrow{} 6 \overrightarrow{} 7$ $1 \stackrel{\frown}{\longrightarrow} 2 \stackrel{\frown}{\longrightarrow} 3 \stackrel{\frown}{\longrightarrow} 4$

Note:


SWING operation may stop temporarily when the fan in the unit is rotating at very low speed or stopping.

· If leaking battery fluid comes in contact with your skin, eyes, or mouth, immediately rinse with plenty of clean water, and consult your physician.

· Obstacles such as a curtain or wall between the remote controller and the indoor unit may affect the appropriate signal transmission.



- · Do not apply strong shocks to the remote controller.
- · Do not pour water on the remote controller.
- · Do not attempt to recharge dry batteries.

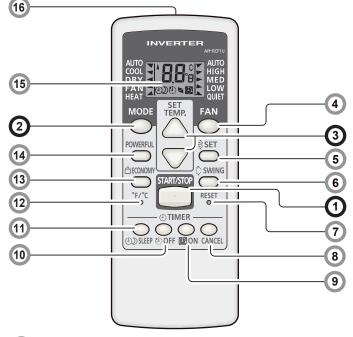

RESET button (7)

When you press the RESET button, press it gently by using the tip of a ballpoint pen or other small object in correct direction as shown in this figure.



8 TIMER CANCEL button

Cancels the set timer.

(9) ON TIMER button

Each time you press the button, the time changes as follows:

 $0.5 \rightarrow 1.0 \rightarrow 1.5 \rightarrow 2.0 \rightarrow \cdots \rightarrow 9.0 \rightarrow 9.5 \rightarrow 10 \rightarrow 11$ →12 hours

• Set the time while the 💭 indicator on the remote controller display is blinking

10 OFF TIMER button

Each time you press the button, the time changes as follows:

- **>**0.5 → 1.0 → 1.5 → 2.0 → ··· → 9.0 → 9.5 → 10 → 11 → 12 hours
- Set the time while the 🕑 indicator on the remote controller display is blinking.

The setting must be done while the setting screen is displayed for *. each function.

1: The button is controllable only when the air conditioner is on.

(continued)

* 🛾

*

* 🛾

Program timer (combined use of the ON timer and the OFF timer)

You can set an integrated ON-OFF or OFF-ON timer as follows:

ON–OFF (€) ◀ (€)	Set the ON timer first. Then set the OFF timer by the air conditioner starts opera- tion controlled with the ON timer earlier set.
OFF–ON Č ► 💽	Set the OFF timer first. Then set the ON timer by the air conditioner stops opera- tion controlled with the OFF timer earlier set.

The timer that is set later starts counting down after the counting down of the preceding timer is finished.

Note:

If you change the setting value for the timer after the program timer is set, the counting down of the timer will be reset at that moment.

11 SLEEP TIMER button


Each time you press the button, the time changes as follows:

→1.0 -	\rightarrow 2.0 \rightarrow 3.0 \rightarrow 5.0 \rightarrow 7.0	→ 9.0	
	CANCEL	hours	

 Set the time while the (1) indicator on the remote controller display is blinking.

To repeat the timer, press the button when the indicator is not displayed.

To help you to fall asleep comfortably and prevent excessive warming or cooling in sleep, the SLEEP timer controls the temperature setting automatically in accordance with the set time shown as follows. The air conditioner completely turns off after the set time has elapsed.



Note for TIMER settings:

Any interruption of the power supply, such as a blackout or cutting off of a circuit breaker, makes the set internal clock go wrong. In such a case, the TIMER indicator on the indoor unit blinks, and you need to readjust the setting.

12 °F/°C button

- Used for changing the temperature unit. (Initial setting: $^\circ F$)
- When you press this button, the displayed temperature unit switches to "°C", and returns to "°F" when you press it again.
- When you press this button, press it gently by using the tip of a ballpoint pen or other small object in correct direction as shown in this figure.



13 ECONOMY button

Starts or stops ECONOMY operation that saves more electricity consumption than the other operations with a conservative adjustment of the room temperature.

When you press the button, the ECONOMY indicator on the indoor unit turns on.

 In COOL mode, the room temperature will be adjusted at a few degree higher than the defined temperature.
 In HEAT mode, the room temperature will be adjusted at a few

degree lower than the defined temperature.

• Especially in COOL mode, you can have improved dehumidification without significantly lowering the room temperature.

Notes:

- In COOL or HEAT mode, the maximum output of this operation is approximately 70% of usual air conditioning operation.
- When at FAN mode, the fan speed will slow down by 1 step. (high > medium, medium > low, low > quiet, quiet > more quiet)
- This operation cannot be performed during temperature monitoring by AUTO mode.

14 POWERFUL button

Starts POWERFUL operation that enables quick cooling down or warming up of the room.

When you press the button to start the POWERFUL operation, the indoor unit emits 3 short beeps.

POWERFUL operation is automatically turned off in the following situations:

- Adjusted room temperature reached to the defined temperature in temperature setting in COOL, DRY, or HEAT mode.
- 20 minutes have passed after finishing the POWERFUL operation mode setting.

Even in situations above, the POWERFUL operation will not

automatically turn off unless it has run for a certain amount of time. **Notes:**

- The airflow direction and the fan speed are controlled automatically.
- This operation cannot be performed simultaneously with ECONOMY operation.

To return to normal operation, press the button again. Then the indoor unit emits 2 short beeps.

15 Remote controller display

In this section, all the possible indicators are displayed for description. In actual operation, the display is linked with the button operation, and only shows the necessary indicators for each setting.

16 Signal transmitter

*

*

*

Aim to signal receiver of the indoor unit properly.

- Signal transmit indicator on the remote controller display shows that signal from the remote controller is being transmitted.
- Operating range is approximately 22 ft (7 m).
- You will hear a beep if the transmitted signal has been sent properly. If there is no beep, press the button on the remote controller again.

Automatic defrosting operation

When outdoor temperature is very low with high humidity, frost may form on the outdoor unit during the heating operation, and it could reduce the operating performance of the product. For frost protection, a microcomputer-controlled automatic defrost function is equipped in this air conditioner. If frost forms, the air conditioner will temporarily stop, and

defrost circuit will operate briefly (maximum of 15 minutes.) OPERATION indicator on the indoor unit blinks during this operation.

If frost forms on the outdoor unit after the heating operation, the outdoor unit will stop automatically after it operates for a few minutes. Then the automatic defrosting operation starts.

Auto-restart function

In event of power interruption such as a blackout, the air conditioner stops once. But it restarts automatically and performs previous operation when the power supply is resumed.

If any power interruption occurs after the timer is set, counting down of the timer will be reset.

After the power supply is resumed, the TIMER indicator on the indoor unit blinks to notify you that there has been a timer fault. In such a case, reset the timer for your opportune time.

Malfunctions caused by other electrical devices:

Use of other electrical appliances such as an electric shaver or nearby use of a wireless radio transmitter may cause the malfunction of the air conditioner.

If you encounter such a malfunction, turn off the circuit breaker once. Then turn it on again, and resume operation by using the remote controller.

*

Remote Controller Overview and Operations

Automatic Defrosting operation

When outdoor temperature is very low with high humidity, frost may form on the outdoor unit during the heating operation, and it could reduce the operating performance of the product. For frost protection, a microcomputer-controlled automatic defrost function is equipped in this air conditioner. If frost forms, the air conditioner will temporarily stop, and defrost circuit will operate briefly (maximum of 15 minutes.) OPERATION indicator on the indoor unit blinks during this operation.

If frost forms on the outdoor unit after the heating operation, the outdoor unit will stop automatically after it operates for a few minutes. Then the automatic Defrosting operation starts.

Auto-restart function

In event of power interruption such as a blackout, the air conditioner stops once. But it restarts automatically and performs previous operation when the power supply is resumed.

If any power interruption occurs after the timer is set, counting down of the timer will be reset.

After the power supply is resumed, the TIMER indicator on the indoor unit blinks to notify you that there has been a timer fault. In such a case, reset the timer for your opportune time.

Malfunctions caused by other electrical devices:

Use of other electrical appliances such as an electric shaver or nearby use of a wireless radio transmitter may cause the malfunction of the air conditioner.

If you encounter such a malfunction, turn off the circuit breaker once. Then turn it on again, and resume operation by using the remote controller.

Remote controller custom code setting


When two or more air conditioners are installed in a room and the remote controller is operating an air conditioner other than the one you wish to set, change the custom code of the remote controller to operate only the air conditioner you wish to set (4 selections possible).

Use the following steps to select the custom code of the remote controller. (Note that the air conditioner cannot receive a signal if the air conditioner has not been set for the matching custom code.)

- 1 Press the Start/Stop button until the remote controller display is turned off.
- 2 Press the "MODE" button for at least five seconds to display the current custom code (initially set to A).

Press the "SET TEMP." (▲) (▼) button

to change the custom code between



Match the code on the display to the air conditioner custom code.

4 Press the MODE button again and the display will be turned off. The custom code will be changed.

NOTES:

A↔B↔C↔D

3

- If no buttons are pressed within 30 seconds after the custom code is displayed, the display returns to the original display. In this case, start again from step 1.
- The air conditioner custom code is set to A prior to shipment. Contact our authorized service personnel to change the custom code.
- Depending on the remote controller, the remote controller custom code may return to custom code A when the batteries are replaced. In this case, if you use a code other than A, reset the code after replacing the batteries.

If you do not know the air conditioner custom code setting, try each code $(A \rightarrow B \rightarrow C \rightarrow D)$ until you find the code which operates the air conditioner.

Care and Cleaning

• Before cleaning the indoor unit, be sure to turn it off and all the power supply has been disconnected.

• Before starting operation, make sure that the intake grille has been shut completely. Incomplete closing of the intake grille might have an effect on the proper working or performance of the air conditioner.

- Do not touch the aluminum fins of heat exchanger built-in the indoor unit to avoid personal injury when you maintain the unit.
- Do not expose the indoor unit to liquid insecticides or hair sprays.
- · Do not stand on slippery, uneven or unstable surfaces when you maintain the unit.


Daily care

When cleaning the indoor unit body, mind the following:

- Do not use water hotter than 108°F (40°C).
- Do not use scouring cleanser, volatile solvents such as benzene or thinner.
- Wipe the unit gently by using soft cloth.

Cleaning the intake grille


Open the intake grille in direction of the arrow a. While gently pressing the left and right mounting shafts of the intake grille outward p, remove the intake grille in direction of the arrow c.

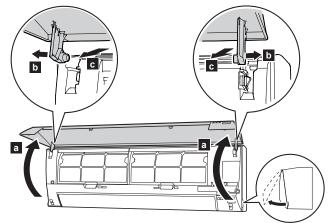

2) Wash the intake grille gently with water or wipe it gently with a soft cloth moisten with warm water.


Then wipe it with a dry and soft cloth.

While holding the grille horizontal, set the left and right mounting shafts into the pillow blocks at the top of the panel a. To latch each shaft properly, insert the shaft until it snaps. Then close the intake grille **D**.

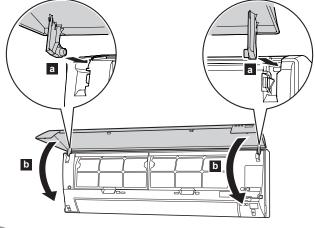



Press 4 places on the intake grille to close it completely.



Cleaning the air filters

Mind that you have a periodical cleaning of the air filters to prevent reducing the operation efficiency of the product.


Using of clogged air filter with dust will lower the product performance, and may cause airflow reduction or increase of operating noise.

Clean the air filters once every 2 weeks under normal use.



Pull up the handle a of the filter in direction of the arrow and release the 2 claws **b**.

Then pull the filter out with gently sliding it downward c.



2 Remove dust by using a vacuum cleaner or by washing the filter. When you wash the filter, use neutral household detergent and warm water.

After rinse the filter well, dry it thoroughly in a shaded place before you reinstall it.

3 Attach the air filter with aligning both side of the filter with the panel, and push in the filter fully.

Note:

Make sure that 2 claws are firmly snapped to the guide holes on the panel.

After extended non-use of the unit

If you have shut down the indoor unit for 1 month or more, perform the FAN operation for half a day to dry the internal parts thoroughly before you perform normal operation.

Additional inspection

After long period of use, accumulated dust inside the indoor unit may reduce the product performance even if you have maintained the unit with instructed daily care or cleaning procedures written in this manual.

In such a case, the product inspection is recommended.

For more information, consult authorized service personnel.

Filter Indicator Reset (Special setting)

This function can be used if set correctly during installation.
Please consult authorized service personnel in order to use this function.
Clean the air filter when the indicator lamp show the following;

ECONOMY indicator	Flashes 3 times, at intervals of 21 seconds
-------------------	---

After cleaning, reset the filter indicator by pushing the MANUAL AUTO button on the indoor unit for 3 seconds or less.

Troubleshooting



In following events, immediately stop operation of the air conditioner, and disconnect all the power supply by turning off the electrical breaker or disconnecting the power plug. Then consult your dealer or authorized service personnel. As long as the unit is connected to the power supply, it is not insulated from the power supply even if the unit is turned off. • Unit smells of something burning or emits smoke

Water leaks from the unit

Following symptoms do not indicate the product malfunction, but they are normal functions or characteristics of this product.

Symptom	Cause	See page
Operation is delayed after restart.	To prevent blowout of the fuse, the compressor will not operate during the protection circuit is working for about 3 minutes after sudden OFF→ON operation of the power supply.	_
Noise is heard.	 During the operation or immediately after stopping the air conditioner, refrigerant flowing sound may be heard. And it is particularly noticeable for 2–3 minutes after starting operation. During the operation, a slight squeaking sound produced by the minute expansion and contraction of the front panel caused by temperature change may be heard. 	_
	During heating operation, a sizzling sound produced by the automatic defrosting operation may be heard.	4
Smell coming from the unit.	Absorbed room smell generated from interior textile, furniture, or cigarette smoke into the air condi- tioner may be emitted.	_
Mist or steam is emitted from the unit.	In COOL or DRY mode, a thin mist generated by condensation formed with sudden cooling process may be emitted.	_
	During heating operation, the fan built-in the outdoor unit may stops and rising steam generated by the automatic defrosting operation may be seen.	4
Airflow is weak or stops.	 Immediately after the heating operation is started, the fan speed stays temporarily very low to warm up the internal parts of the unit. In HEAT mode, the outdoor unit stops and the indoor unit operates at very low fan speed if the room temperature rises above the set temperature. 	_
	In HEAT mode, the indoor unit temporarily stops for maximum of 15 minutes to perform the automatic defrosting operation while the OPERATION indicator is flashing.	4
	In DRY mode, the indoor unit operates at low fan speed to adjust the room humidity, and may stop from time to time.	_
	When the fan speed is set to "QUIET", the fan rotates at very low speed and the airflow is reduced.	_
	When monitoring operation is performed in AUTO mode, the fan rotates at very low speed.	-
Outdoor unit emits water.	During heating operation, the outdoor unit may emit water generated by the automatic defrosting operation.	_

When the filter sign is set, the LED lamp may flash. In this case, please refer to "Filter Indicator Reset (Special setting)".

Before you call for or request servicing, troubleshoot a problem by performing following checks:

Symptom	Diagnostic	
Does not operate at all.	 Has the circuit breaker been turned off? Has there been a power outage? Has a fuse blown out or the circuit breaker been tripped? 	-
	□ Is the timer operating?	3, 4
Poor cooling or heating perfor-	□ Is the air filter dirty?	6
mance.	□ Is the intake grille or outlet port of indoor unit blocked?	_
	□ Is the room temperature adjusted appropriately?	3
	 Is a window or door left opened? Is direct or strong sunlight shinning into the room in cooling operation? Are there other heating apparatus or computers operating, or too many people in the room in cooling operation? 	_
	□ Is the fan speed set to "QUIET"?	3
The unit operates differently from the remote controller setting.	 Are the batteries used in the remote controller exhausted? Are the batteries used in the remote controller loaded properly? 	2

Immediately stop operation and turn off the electrical breaker in following cases. Then consult authorized service personnel.

• The problem persists even if you perform these checks or diagnostics.

• The OPERATION indicator and TIMER indicator blink while the ECONOMY indicator is blinking fast.

Operating Range

	COOL/DRY mode	HEAT mode
Outdoor temperature	15 to 115°F (-10 to 46°C)	15 to 75°F (-10 to 24°C)
Indoor temperature	64 to 90°F (18 to 32°C)	60 to 88°F (16 to 30°C)
Indoor humidity	80% or less	_